


Top surface of P.C. Beams shall be intentionally roughened to a minimum height of 1/4" over a maximum pitch of 2" measured longitudinally along the length of the beam. The crest and trough associated with the height shall not be less than 1/2" and shall extend the full width of the top flange. Roughened surface may be obtained by a special trowel as shown in the examples, by cleaning the concrete surface with a stiff wire brush (or blasting) to the extent that aggregate is exposed to a height of 1/4", or by another approved method. The method used shall be submitted for approval by the Engineer. Repair any damage to reinforcement epoxy coating before placement of deck concrete.



6'-5"

5'-8'

V2 #4 × 1'-9"

1'-2"

1'-2"

V1 #4 x 3'-4"

1'-8"

1'-8"

2 1/2"

## NOTE: The Dead Load Deflection shown above at the tenth points are the initial deflections due to Deck Slab + Diaphragms + 5 p.s.f. Deck Form Allowance + Concrete Traffic Rail. It does not include the Beam weight or Future Wearing Surface.


1'-2"


C #5 x 8'-0"

1'-2"

2'-0"

4 3/4"

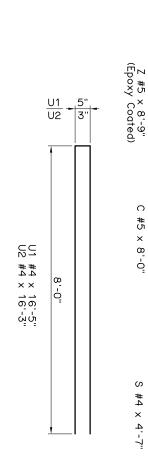

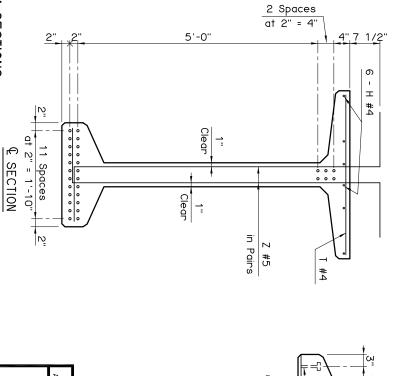

NOTE: Encased Sole Plate located at each end of Beam.

2 Spaces at 2" = 4"

V2 #4

V1 #4

#4

- H #4

#4

5'-0"

1" Clear

12 - U2 #4 @ 4" = 3'-8"

Clear

in Pairs C #5

. 1'-3"

#4

at 2"

11 Spaces = 1'-10"

אַ

END SECTION

BEAM SECTIONS

(30 - 0.6" Ø STRANDS)

NTEGRAL

SHEET 2 OF 2)

OKLAHOMA DEPT. OF TRANSPORTATION
BRIDGE STANDARD (ENGLISH)
TYPE BT-72 P.C. BEAM DETAILS
95' SPAN

DATE 8/27/07

