

TYPICAL RAMP SECTION - LINE 4

STA. 343+00.00 TO STA. 350+86.76



- (1) DISTANCE VARIES SEE CROSS SECTIONS.
- (2) THE PROPOSED CONSTRUCTION SHALL MATCH THE EXISTING PAVEMENT BOTH HORIZONTALLY AND VERTICALLY.

PC CONCRETE REQUIREMENT	
13' PAVT. STRUCTURE	
SURFACE COURSE	9.0" DOWEL JOINTED PC CONCRETE
BASE COURSES	4.0" CEMENT TREATED BASE

SEGMENT	WIDTH	EXTENTS
A	TRANS. 4'-0" TO 10'-0"	STA. 343+00.00 TO STA. 350+86.76

- ① BACKFILL NOTE:
THIS AREA TO BE BACKFILLED AND COMPACTED AS PART OF THE FINISHING OPERATIONS. QUANTITY IS MEASURED IN UNCLASSIFIED BORROW.
- ② TOPSOIL NOTE:
THE CONTRACTOR SHALL STRIP ALL OF THE AVAILABLE TOPSOIL, STOCKPILE IT, AND PLACE IT BACK ON THE SECTION IN ACCORDANCE WITH SECTION 205 OF THE STANDARD SPECIFICATIONS. RESERVED TOPSOIL SHALL BE SPREAD FIRST ON THE COMPLETED SLOPES OF THE CUT SECTIONS AND THE REMAINDER ON COMPLETED FILL SLOPES OR OTHER PRIORITY AREAS LOCATED BY THE ENGINEER. ALL ADDITIONAL COSTS ASSOCIATED WITH OPERATION SHALL BE INCLUDED IN THE PAY ITEM FOR SALVAGED TOPSOIL, LUMP SUM.

THE GRADING LINE AS SHOWN ON THE TYPICAL AND CROSS SECTIONS IS TO THE TOP OF THE TOPSOIL. EARTHWORK QUANTITIES WERE NOT ADJUSTED FOR SALVAGE AND THE TOPSOIL.
- ③ SEPARATOR FABRIC:
SHALL BE 15 OZ/S.Y., AS DIRECTED BY SPECIAL PROVISION 317 CEMENT TREATED BASE. COST SHALL BE INCLUDED IN PRICE BID FOR CEMENT TREATED BASE.
- ④ SEE CROSS SECTIONS.

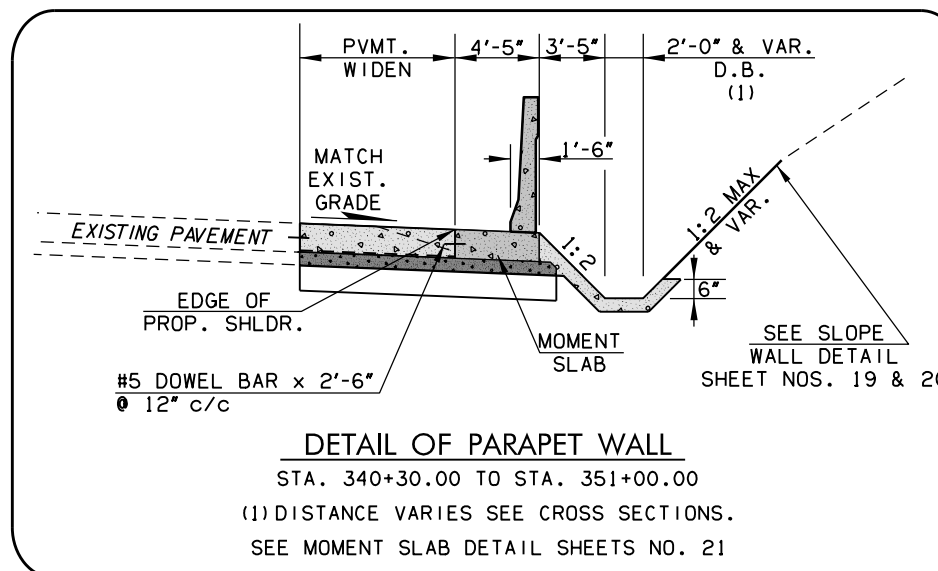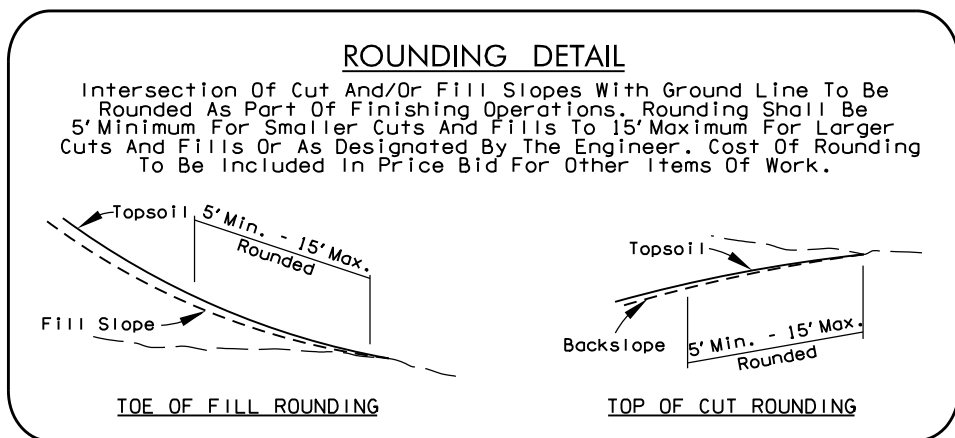

DETAIL OF PARAPET WALL

STA. 340+30.00 TO STA. 351+00.00

- (1) DISTANCE VARIES SEE CROSS SECTIONS.
- SEE MOMENT SLAB DETAIL SHEETS NO. 21

DESIGN	-	-
DRAWN	-	-
CHECKED	-	-
APPROVED	-	-
SQUAD	POE	

TYPICAL SECTIONS SHEET 5 OF 6

STATE JOB NO. 30444(06) SHEET NO. 6