


DESCRIPTION	REVISIONS	DATE

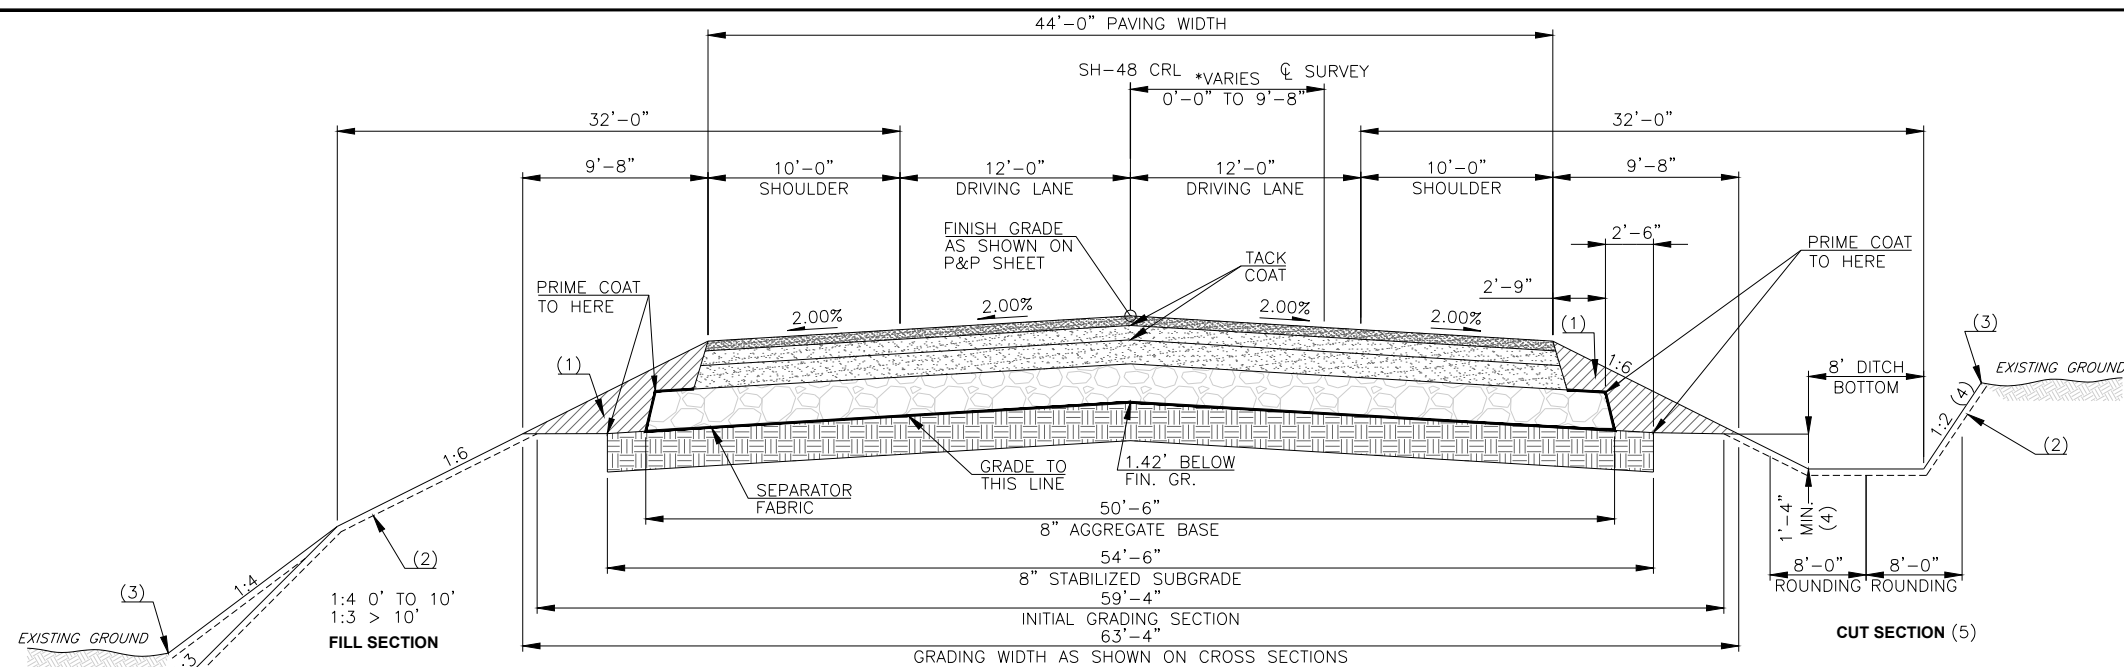


- (1) BACKFILL NOTE:  
THIS AREA TO BE BACKFILLED AND COMPACTED AS A PART OF THE FINISHING OPERATIONS. QUANTITY IS MEASURED IN TBSC TYPE E.
- (2) TOPSOIL NOTE:  
THE CONTRACTOR SHALL STRIP ALL OF THE AVAILABLE TOPSOIL, STOCKPILE IT, AND PLACE IT BACK ON THE SECTION IN ACCORDANCE WITH SECTION 205 OF THE STANDARD SPECIFICATION. RESERVED TOPSOIL SHALL BE SPREAD FIRST ON THE COMPLETED SLOPES OF THE CUT SECTIONS AND THE REMAINDER ON COMPLETED FILL SLOPES OR OTHER PRIORITY AREAS LOCATED BY THE ENGINEER. ALL ADDITIONAL COSTS ASSOCIATED WITH OPERATION SHALL BE INCLUDED IN THE PAY ITEM FOR SALVAGED TOPSOIL, LUMP SUM. THE GRADING LINE IS TO THE TOP OF THE TOPSOIL. EARTHWORK QUANTITIES WERE NOT ADJUSTED FOR SALVAGE AND THE TOPSOIL QUANTITY IS INCLUDED IN THE MASSLINE BALANCE.
- (3) SEE ROUNDING DETAIL.
- (4) UNLESS OTHERWISE NOTED ON CROSS SECTIONS.
- (5) TERMINATE THE BACK SLOPE OF THE CUT SECTION IF AND WHEN IT ENCOUNTERS SANDSTONE OUTCROPPINGS.

**LEFT**  
**STA. 351+00.00 TO STA. 352+21.62**  
**STA. 383+20.36 TO STA. 388+51.26**

**RIGHT**  
**STA. 351+00.00 TO STA. 351+71.62**  
**STA. 382+71.13 TO STA. 388+51.26**

\*STA. 383+20.36 TO STA. 388+51.26 - TRANSITION 9'-8" TO 0'-0"

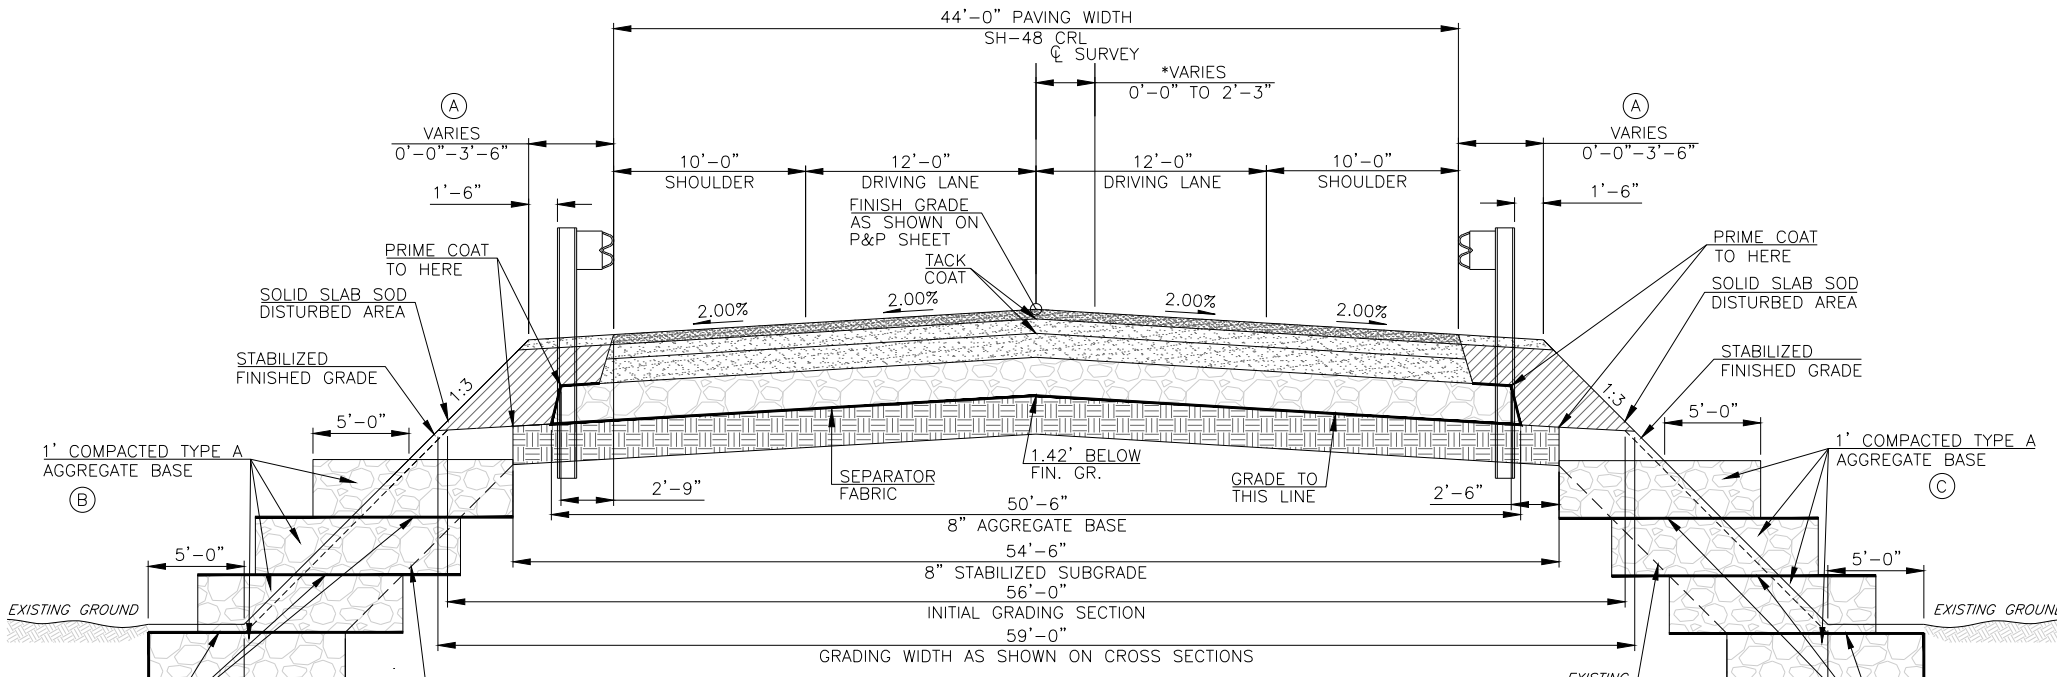


**LEFT**  
**STA. 352+21.62 TO STA. 365+00.00**

**RIGHT**  
**STA. 351+71.62 TO STA. 365+00.00**



(A) 0'-0" TO 3'-6" FROM STA. 352+21.62 TO STA. 352+71.62  
 3'-6" FROM STA. 352+71.62 TO STA. 365+00.00

(A) 0'-0" TO 3'-6" FROM STA. 351+71.62 TO STA. 352+21.62  
 3'-6" FROM STA. 352+21.62 TO STA. 365+00.00

\*STA. 362+60.29 TO STA. 365+00.00 - TRANSITION 0'-0" TO 2'-3"

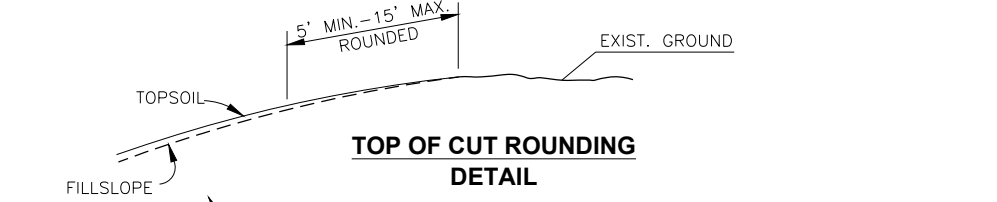

INTERSECTION OF CUT AND/OR FILL SLOPES WITH GROUND LINE TO BE ROUNDED AS PART OF FINISHING OPERATIONS. ROUNDED SHALL BE 5' MINIMUM FOR SMALLER CUTS AND FILLS TO 15' MAXIMUM FOR LARGER CUTS AND FILLS OR AS DESIGNATED BY THE ENGINEER. COST OF ROUNDED TO BE INCLUDED IN PRICE BID FOR OTHER ITEMS OF WORK.

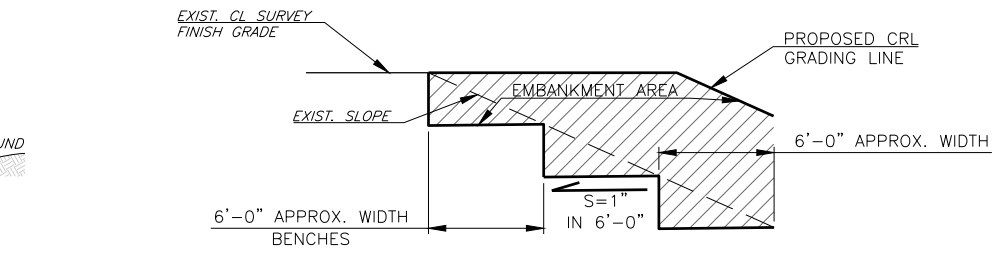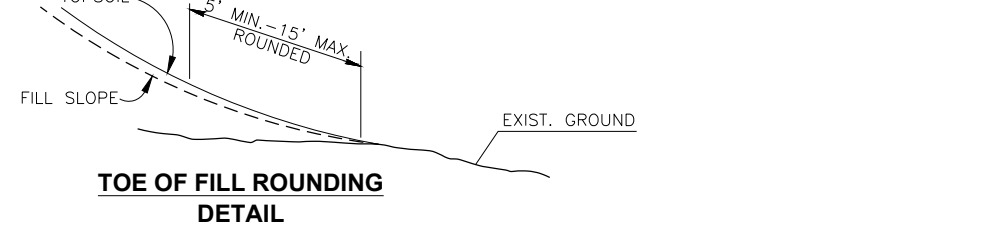

EXISTING CL SURVEY SLOPE SHALL BE CONTINUOUSLY BENCHED. BEGINNING AT THE LOWER LIMITS OF THE SLOPE. WIDTH OF BENCH SHALL BE APPROX. 6'-0". BENCHING EXTENTS SHALL BE DETERMINED BY THE ENGINEER. SALVAGE TOPSOIL PRIOR TO BENCHING. BENCHING WILL BE INCLUDED IN OTHER ITEMS OF WORK.

- (B) PLACE GEOTEXTILE AND AGGREGATE STA 359+25.00 TO STA 365+00.00 THROUGH EXTENTS OF SOFT SOIL. SEE PEDOLOGICAL SOIL SURVEY FOR MORE INFORMATION.
- (C) PLACE GEOTEXTILE AND AGGREGATE STA 359+25.00 TO STA 364+00.00 THROUGH EXTENTS OF SOFT SOIL. SEE PEDOLOGICAL SOIL SURVEY FOR MORE INFORMATION.

PAVEMENT REQUIREMENT			
9" PAVT. STRUCTURE	12'-0" DRIVING LANES	10'-0" PAVED SHOULDERS	3'-6" GUARDRAIL WIDENING SECTION
SURFACE COURSE	2" SUPERPAVE TYPE S4 (PG 64-22 OK)	2" SUPERPAVE TYPE S4 (PG 64-22 OK)	2" SUPERPAVE TYPE S4 (PG 64-22 OK)
BASE COURSE	3" SUPERPAVE TYPE S3 (PG 64-22 OK)	3" SUPERPAVE TYPE S3 (PG 64-22 OK)	
	4" SUPERPAVE TYPE S3 (PG 64-22 OK)	4" SUPERPAVE TYPE S3 (PG 64-22 OK)	