



OKLAHOMA DEPARTMENT OF TRANSPORTATION		
STANDARD REVISIONS		
DESCRIPTION	DATE	

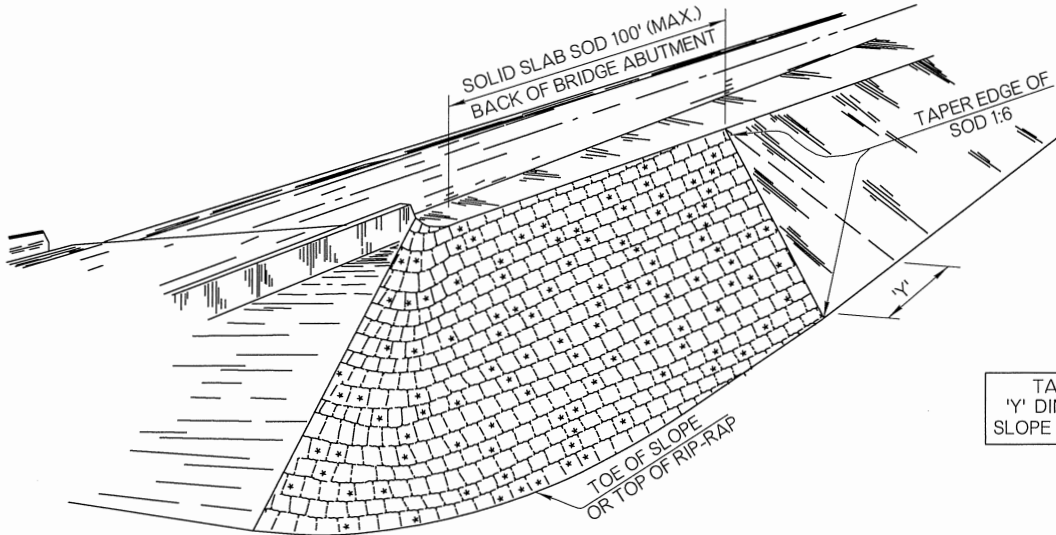

TYPICAL PLACEMENT OF SOLID SLAB SODDING ON FILL SLOPES, APPROACHES TO OVERPASSES AND BRIDGES.

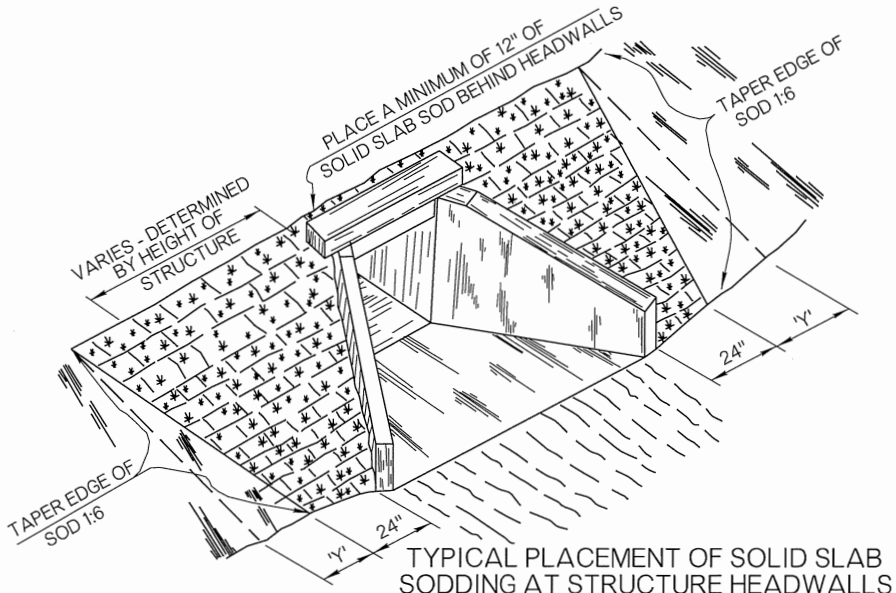


TYPICAL PLACEMENT OF SOLID SLAB SODDING AT STRUCTURE HEADWALLS


TAPER NOTE
'Y' DIMENSION =
SLOPE LENGTH x 0.17

GENERAL NOTES

1. ALL CONSTRUCTION AND MATERIAL REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE 2009 ODOT STANDARD SPECIFICATIONS.
2. SOLID SLAB SOD SHALL BE PLACED IN HORIZONTAL ROWS WITH THE LONGEST SIDE OF EACH SLAB RUNNING PARALLEL TO THE ROADWAY, AND THE SLABS IN ALTERNATE ROWS STAGGERED HALF THE LENGTH OF EACH INDIVIDUAL SLAB. ENSURE THE ROWS RUN PARALLEL TO THE ROADWAY.
3. SLABS SHALL BE CUT AND HARVESTED WITH A COMMERCIAL SOD CUTTER TO THE DIMENSIONS SHOWN, THEN LOADED, TRANSPORTED AND HANDLED ON PALLETS.
4. AFTER PLACEMENT OF SOLID SLAB SOD, EARTH AT THE OUTER EDGES OF THE PLACEMENT SHALL BE BACKFILLED AND LOOSELY COMPACTED TO AT LEAST 1" ABOVE THE TOP OF THE SOLID SLAB SODDING.
5. STAKE SOD ON ALL SLOPES 1:2 OR STEEPER, AND ON ANY AREAS THAT ARE IN SUCH CONDITION THAT THERE IS DANGER OF SOD SLIPPING. PERFORM STAKING CONCURRENTLY WITH SOD PLACEMENT AND PRIOR TO TAMPING WITH SOUND WOODEN STAKES APPROXIMATELY 1 INCH SQUARE OR 1 INCH IN DIAMETER AND NOT LESS THAN 12 INCHES IN LENGTH, OR USE METAL STAPLES IN PLACE OF WOODEN STAKES. PLACE, STAKE AND STAPLE THE SOD WHERE NECESSARY, AND AS DETERMINED BY THE ENGINEER.

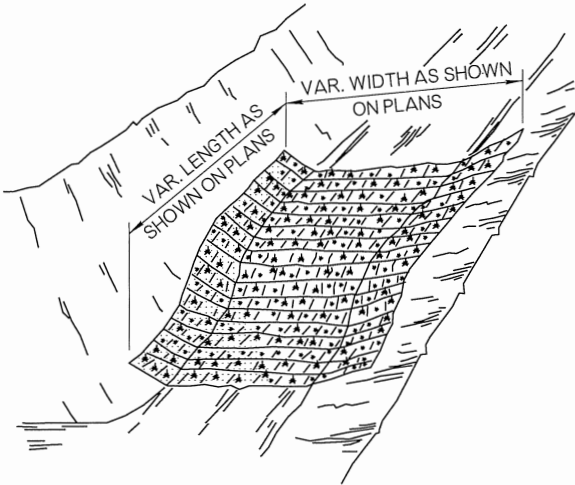

TYPICAL PLACEMENT OF SOLID SLAB SODDING IN DITCHES

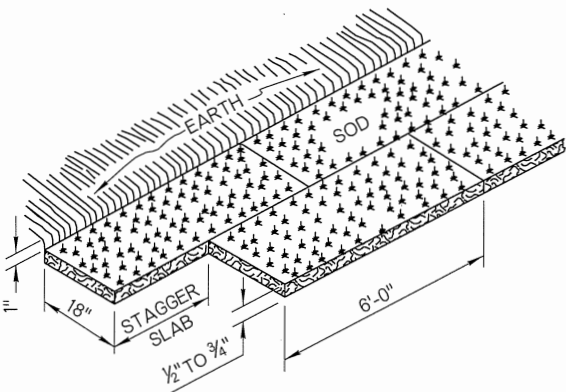

SOLID SLAB SODDING
(MARCH 1 THRU AUGUST 31)

THE PLACEMENT OF SOLID SLAB SOD SHALL BE RESTRICTED TO THE PERIOD FROM MARCH 1 THRU AUGUST 31, UNLESS OTHERWISE APPROVED BY THE ENGINEER.

BASIS OF PAYMENT		
ITEM NO.	ITEM	UNIT
230(A)	SOLID SLAB SODDING	SY



APPROVED BY
ROADWAY ENGINEER: *Calvin F. A.* DATE: *07/16/15*
ROADWAY DESIGN DIVISION STANDARD

SOLID SLAB SODDING